FOR REFERENCE ONLY - DRAWING NOT TO SCALE

Notes:
1. 1.50-11.5 NPT (2 Plcs) is preferred wire entry. CAUTION Conduit must enter at lowest point to prevent water from entering electrical enclosure due to condensation. If hazardous (classified) or Nema 6 location, conduit seals are required at electrical enclosure entrances.
2. Lubrication 0.50-14 NPT plugs.
3. To move actuator to another valve, bronze stem nut P/N 35851 may be threaded up to 2.25" Acme stem max.
4. For electrical control pilot device elements mounted on actuator control cover, see EIM job spec sheet & wiring diagram furnished for each specific job no.

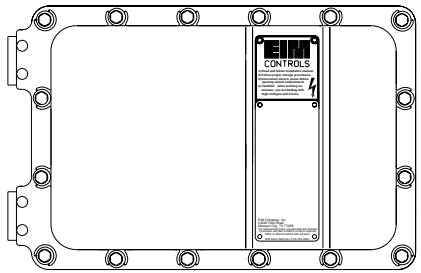

5. WARNING-The installation and servicing instructions are for used by qualified personnel only. To avoid injury and electric shock, do not perform any service on EIM equipment unless qualified.
6. Installation shall be in accordance with current edition of National Electrical Code.

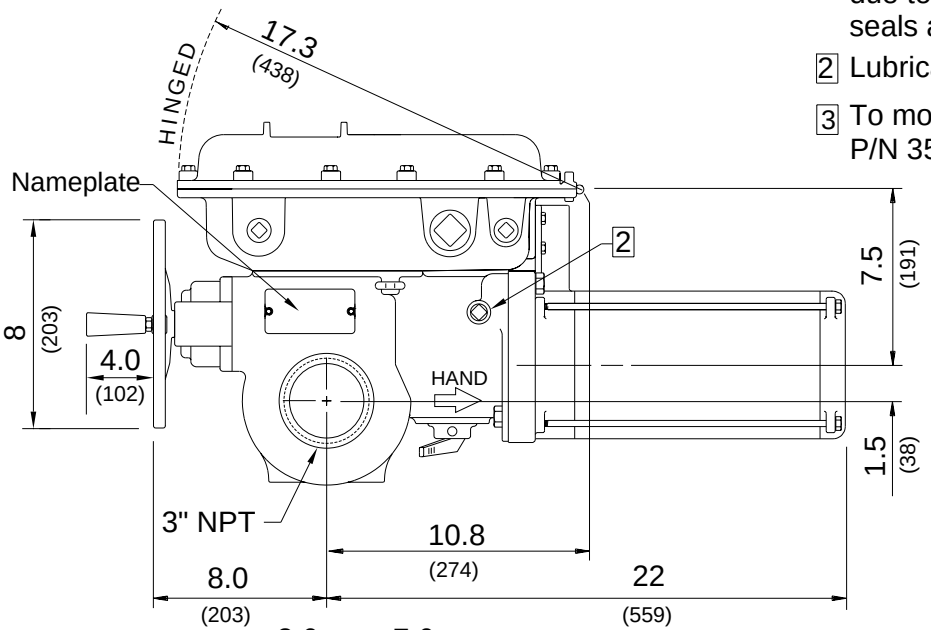

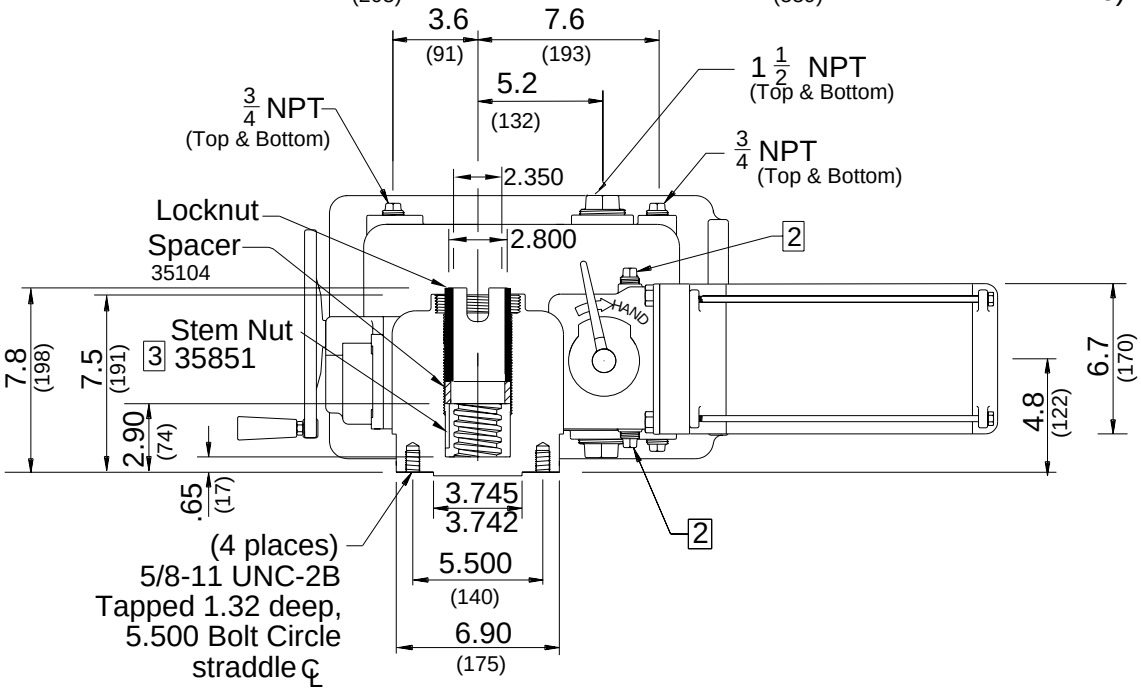

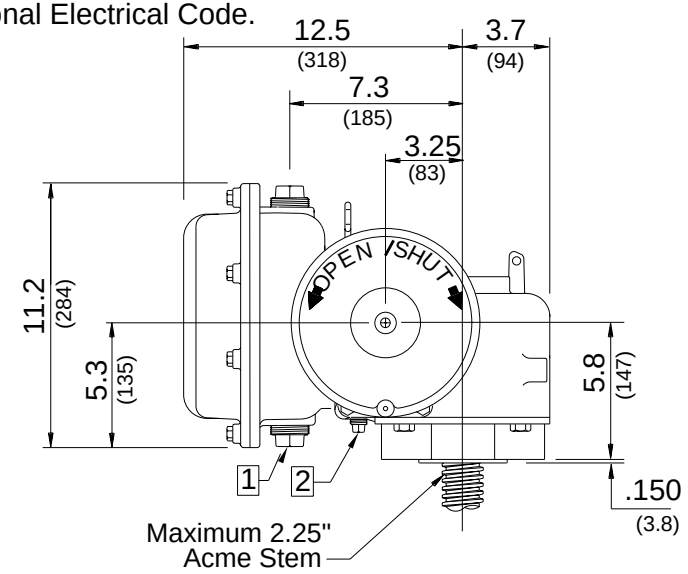

INCHES (MILLIMETERS)
.XXX ± .005"
.XX ± .020"
.X APPROX.

EIM COMPANY, INC.
13840 PIKE ROAD
CONTROLS MISSOURI CITY, TX 77489

REV	DATE	ERO	BY
A	6/15/95	9592	/CML

TITLE: 2000 M/T 5.50

OUTLINE NO. 2-0001/14G REV A

FORM 00934-C