
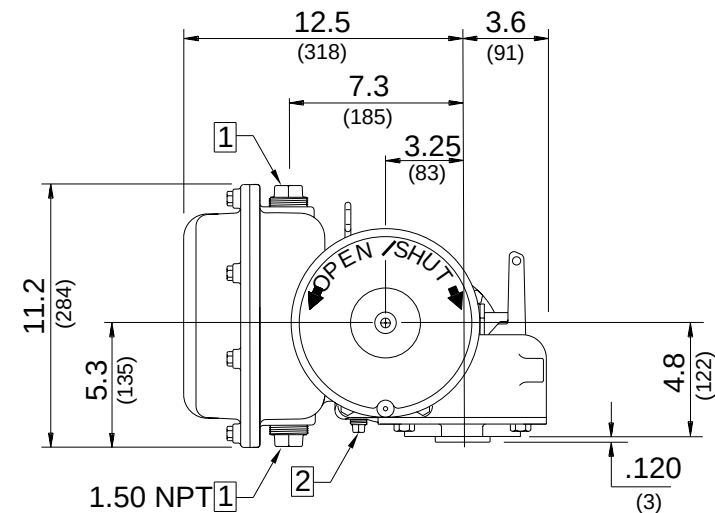
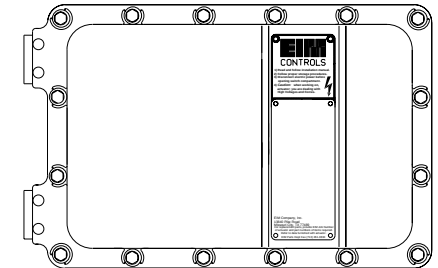


Journal of Management Education 35(1)

- 1 1.50-11.5 NPT (2 places) is preferred wire entry **CAUTION** Conduit must enter at lowest point to prevent water from entering electrical enclosure due to condensation. If hazardous location, conduit seal required at electrical enclosure entrances.
- 2 Lubrication 0.50-14 NPT plugs.
- 3 P/N 35850 Bushing. Maximum bore stem size is 1.25" (1/4" Sq Key)

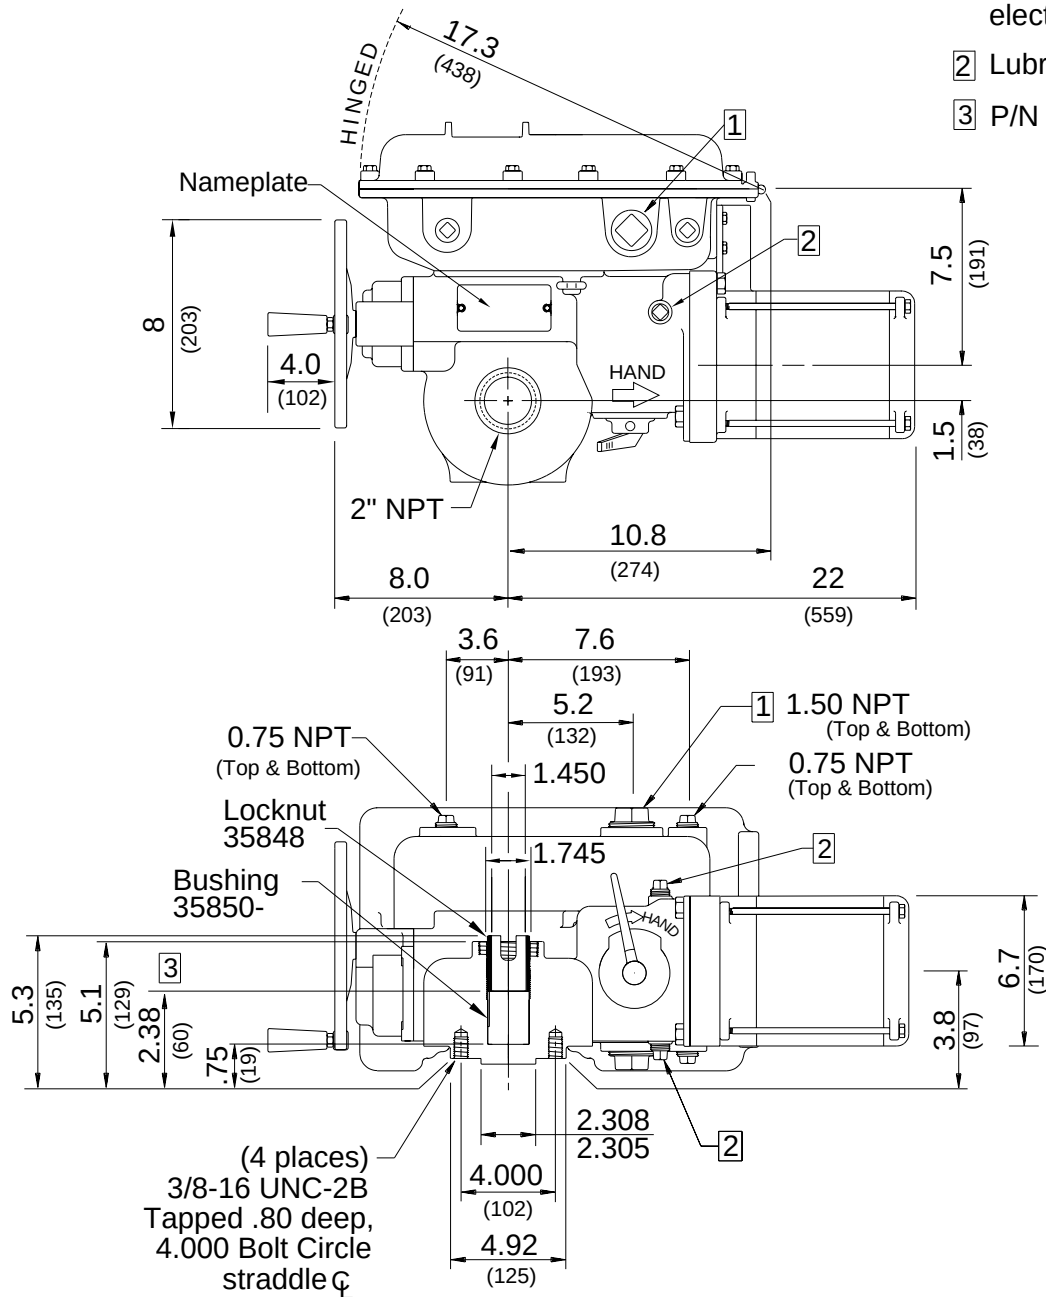

INCHES .XXX ± .005"  
(MILLIMETERS) .XX ± .020"  
.X APPROX.

**EIM** EIM COMPANY, INC.  
13840 PIKE ROAD  
CONTROLS MISSOURI CITY, TX 77489

|             |            |                 |
|-------------|------------|-----------------|
| TITLE       |            | Type D M/T 4.00 |
| OUTLINE NO. | D-0001/10G | REV<br>A        |

|     |         |     |      |
|-----|---------|-----|------|
| A   | 7/18/97 |     | /CMI |
| REV | DATE    | ERO | BY   |