
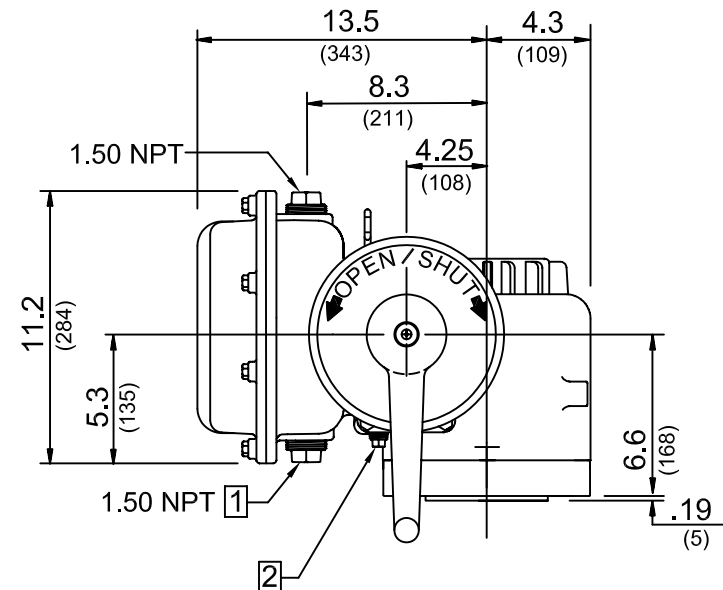
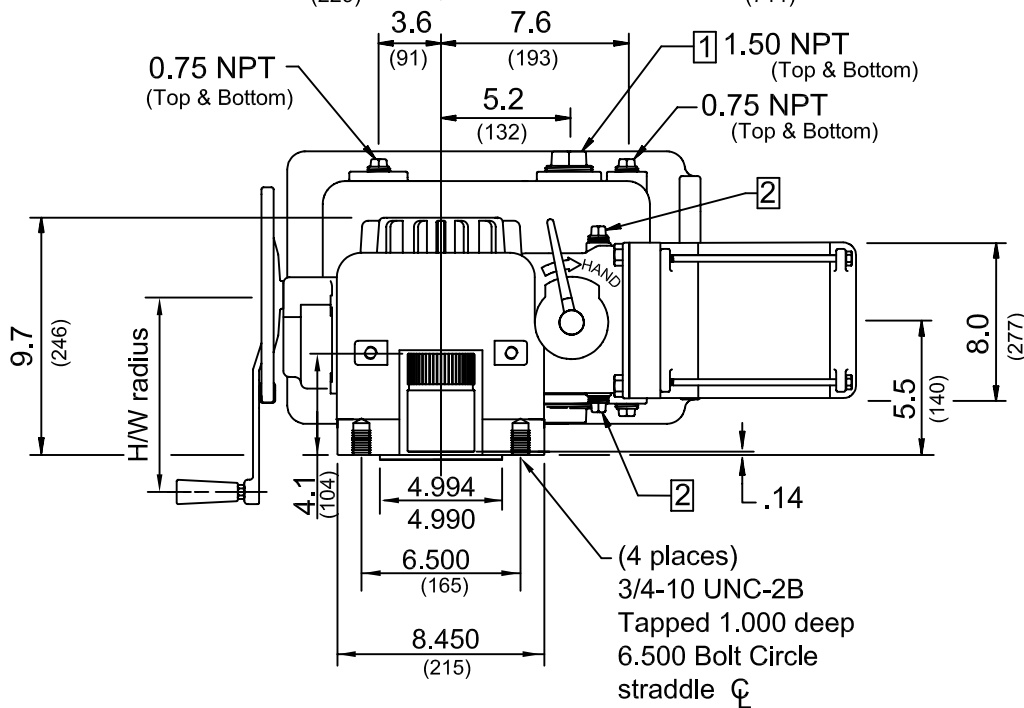
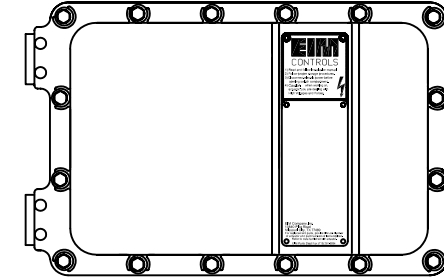


Notes: ① 1.50-11.5 NPT (2 places) is preferred wire entry. CAUTION Conduit must enter at lowest point to prevent water from entering electrical enclosure due to condensation. If hazardous (classified) or Nema 6 location, conduit seals are required at electrical enclosure entrances.

② Lubrication 0.50-14 NPT plugs.

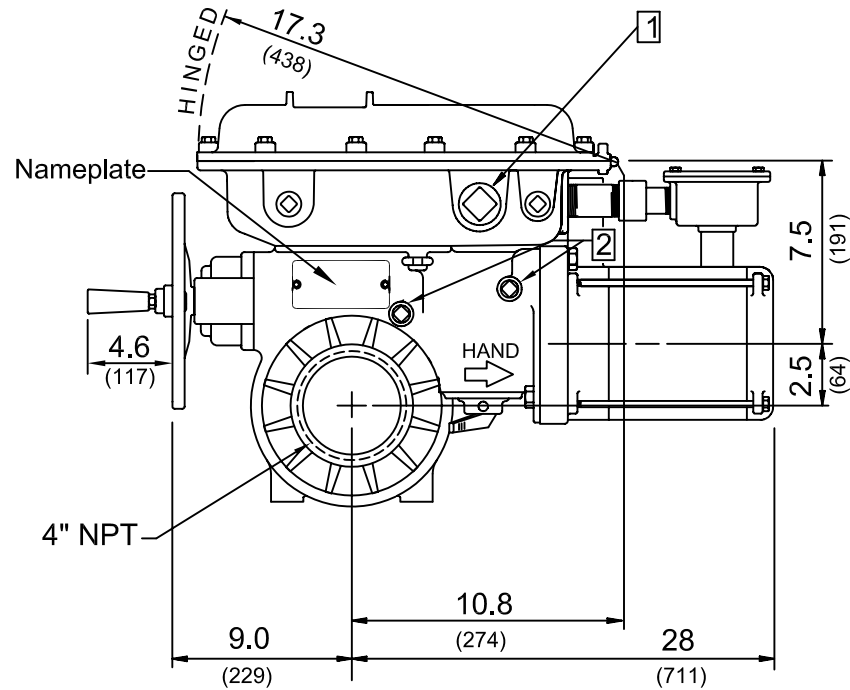

INCHES .XXX ± .005"
(MILLIMETERS) .XX ± .020"
.X APPROX.

EIM EIM COMPANY, INC.
13840 PIKE ROAD
CONTROLS MISSOURI CITY, TX 77489

TITLE **Type S M/T 6.50**
REV B
OUTLINE NO. **S-0002/16G**

B	4/27/01	14395	/CML
REV	DATE	ERO	BY